

Example Catalog #:


D - B - 2/0 - Y - 10

Cable Ends 1 & 2	
B	Universal Grounding Clamp 01-M-037
B2	Two grounding ball studs 25 mm installed on clamp
BD	One grounding ball stud 25 mm installed on right hand side of clamp (jaw facing user)
BG	One grounding ball stud 25 mm installed on left hand side of clamp (jaw facing user)
H	Universal Grounding Clamp 01-M-034
H2	Two grounding ball studs 20 mm installed on clamp
HD	One grounding ball stud 20 mm installed on right hand side of clamp (jaw facing user)
HG	One grounding ball stud 20 mm installed on left hand side of clamp (jaw facing user)
D	Duck Bill Clamp HCDB-117
DS	Duck Bill Clamp with Serrated Jaws HCDB-117S
DP	With parking stud installed
DSP	With parking stud installed
P	20 mm Ball Stud Grounding Clamp HC-10015
Q	25 mm Ball Stud Grounding Clamp HC10015-A
C	C Clamp 01-M-044
C1	C Clamp 01-M-044W for 30 MM Ball stud
U	Universal Grounding Clamp HC-10041
UA	Universal Grounding Clamp HC-10041-A
S	C Clamp HC-10042
M	Cable with ferrule
G	Universal Grounding Clamp 01-M-070A
V	Universal Grounding Clamp 01-M-080

Cable Size	
1/0	1/0 AWG (2H)
2/0	2/0 AWG (3H)
4/0	4/0 AWG (5H)
350	350 MCM (7H)
500	500 MCM

Cable Length (L1)
Cable length in feet

Jacket Type	
B	(Class M) EPDM - black opaque
C	(Class M) Excelene - orange opaque
E	(Class K) Excelene - red opaque
S	(Class K) Silicone - transparent
Y	(Class K) EPDM - yellow opaque

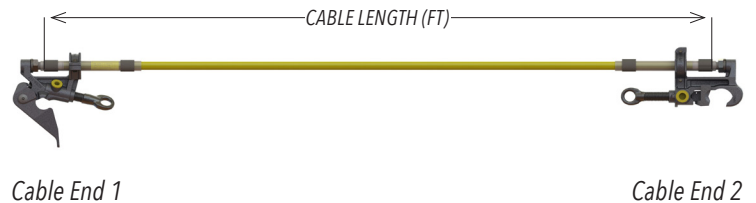

Note: Add "T" suffix after clamp for T-handle HC-10026



Create your own with our MPS Real-Time Design Configurator



Scan code or visit our Resources page at macleanpower.com

Example Catalog #:

D - B - 2/0 - Y - 4 - Y - 8

Cable Ends 1 & 2	
B	Universal Grounding Clamp 01-M-037
B2	Two grounding ball studs 25 mm installed on clamp
BD	One grounding ball stud 25 mm installed on right hand side of clamp (jaw facing user)
BG	One grounding ball stud 25 mm installed on left hand side of clamp (jaw facing user)
H	Universal Grounding Clamp 01-M-034
H2	Two grounding ball studs 20 mm installed on clamp
HD	One grounding ball stud 20 mm installed on right hand side of clamp (jaw facing user)
HG	One grounding ball stud 20 mm installed on left hand side of clamp (jaw facing user)
D	Duck Bill Clamp HCDB-117
DS	Duck Bill Clamp with Serrated Jaws HCDB-117S
DP	With parking stud installed
DSP	With parking stud installed
P	20 mm Ball Stud Grounding Clamp HC-10015
Q	25 mm Ball Stud Grounding Clamp HC10015-A
C	C Clamp 01-M-044
C1	C Clamp 01-M-044W for 30 MM Ball stud
U	Universal Grounding Clamp HC-10041
UA	Universal Grounding Clamp HC-10041-A
S	C Clamp HC-10042
M	Cable with ferrule
G	Universal Grounding Clamp 01-M-070A
V	Universal Grounding Clamp 01-M-080

Cable Size	
1/0	1/0 AWG (2H)
2/0	2/0 AWG (3H)
4/0	4/0 AWG (5H)


Cable Length (L1)
Cable length in feet

Cable Length (L2)
Cable length in feet

Letter "Y"	
Y	Three Phase Assembly

Jacket Type	
B	EPDM - black opaque (Class K)
C	Excelene - orange opaque (Class M)
E	Excelene - red opaque (Class K)
S	Silicone - transparent (Class K)
Y	EPDM - yellow opaque (Class K)

Cable End 1

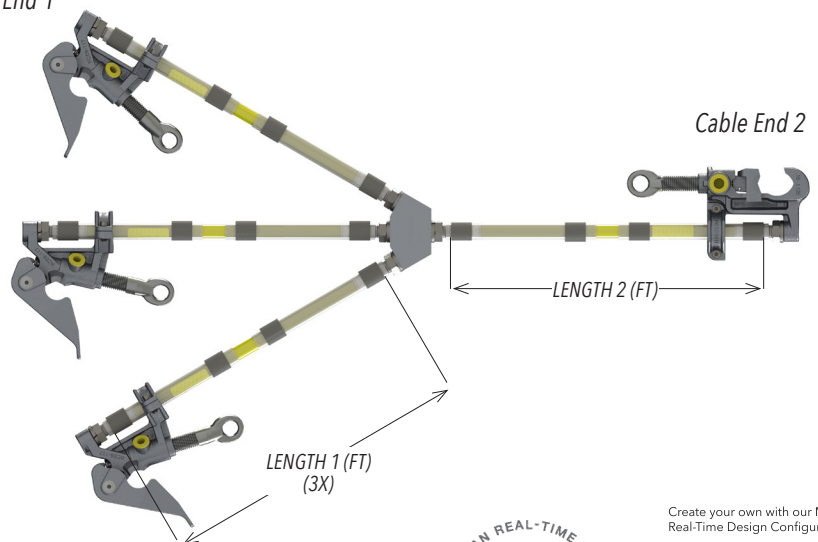

Create your own with our MPS Real-Time Design Configurator



Scan code or visit our Resources page at macleanpower.com